


DAMPER STATUS INDICATOR (MODE 5 24 VOLT)

actionair

©RUSKIN AIR MANAGEMENT LIMITED
 South Street, Whitstable
 Kent CT5 3DU
 Telephone: 01227 276100
 Facsimile: 01227 264262
 www.actionair.co.uk

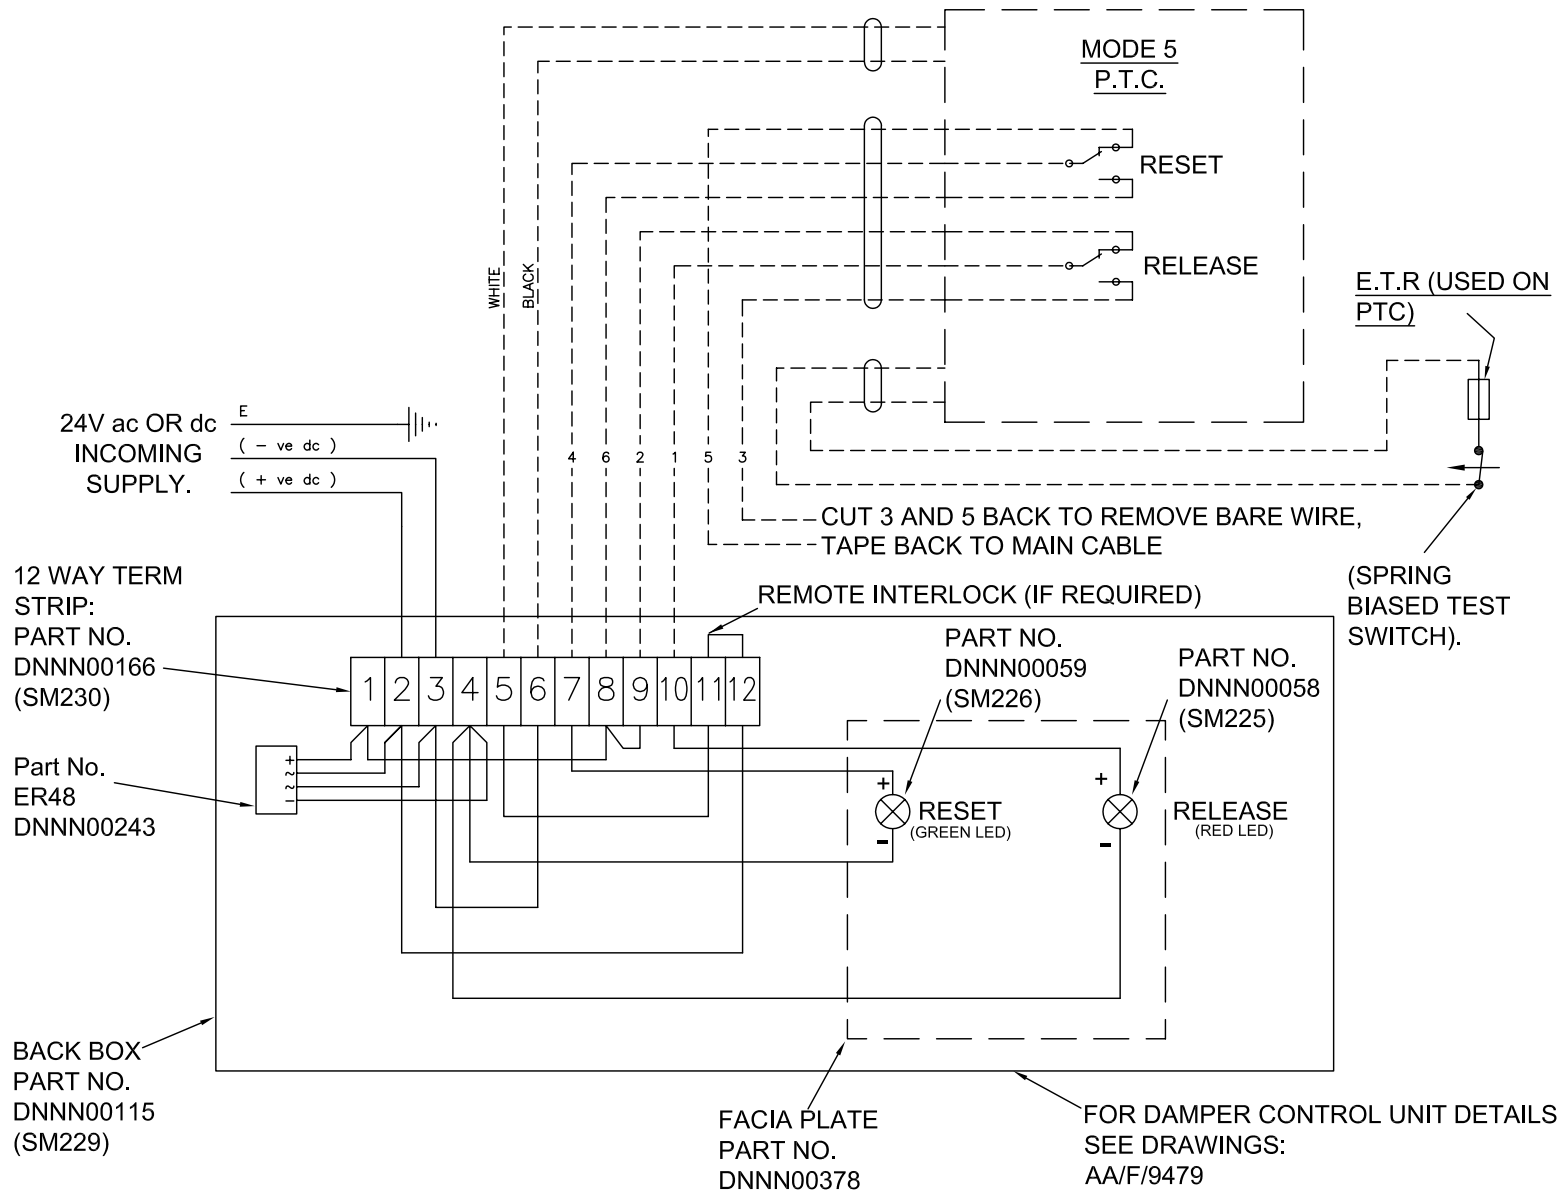

Notes:

EXTRA PARTS NOT LISTED IN DRAWING (FOR CLARITY):

- 1, BLACK WIRE 90mm X 3 DNNN00090
- 2, BLACK WIRE 50mm X 3 DNNN00090
- 3, FOR DAMPER CONTROL UNIT DETAILS, REFER TO DRAWING: AA/F 9479
- 4, FOR NON-ETR MODES, SUBSTITUTE SIGNAL ID 4 WITH 3 AND ID 6 WITH 4.

Rev	Change	Initials	Dates
D	VARIOUS ALTERATIONS	S.W.	17/09/2001
C	NOTES ADDED	A.M.	23/12/2003
B	ETR WIRING ADDED	A.M.	17/09/2001
A	SMOKE/SHIELD PTC DETAILS ADDED.	A.M.	11/11/1998

Drawn By	A.M.	11/09/1996
Checked By	J.H.	04/08/2005
Approved By	S.W.	04/08/2005
Customer	N/A	
Part No:	JNNN00065	

Title
 DAMPER STATUS INDICATOR,
 WIRING DIAGRAM. 24V (DSI24)

Drawing No. AA/F 4079 Revision D

This drawing is confidential communication and is the property of Ruskin Air Management Limited and is returnable on request. It is not to be copied, loaned or communicated without the consent of Ruskin Air Management Limited. This drawing should be considered uncontrolled if it is a printed copy, or has been transmitted outside of Ruskin Air Management Limited, electronically. The live version is the electronic copy held at Ruskin Air Management Ltd. Please confirm the drawing issue before placing any orders which refer to this drawing.